



PLAN VIEW
(NOT TO SCALE)

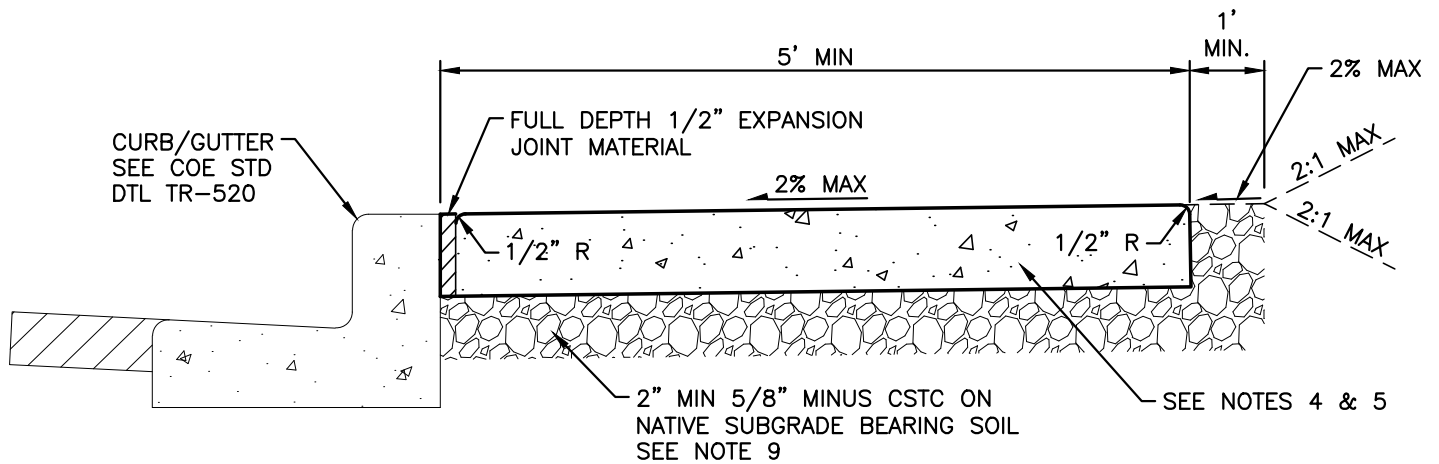


SECTION VIEW
(NOT TO SCALE)

NOTES:

1. CITY INSPECTION REQUIRED ON FORM WORK PRIOR TO POUR.
2. CONCRETE SHALL BE CLASS 3000/COMMERCIAL MIX.
3. FINISH SHALL BE LIGHT BROOM.
4. SIDEWALK THICKNESS SHALL BE 4".
5. SIDEWALK THICKNESS AT DRIVEWAYS AND DRIVEWAY TRANSITIONS SHALL BE 6".
6. CURB AND GUTTER SHALL BE POURED SEPARATELY FROM SIDEWALK.
7. LIDS FOR JUNCTION BOXES AND UTILITY VAULTS SHALL BE NON-SKID AS SPECIFIED BY ENGINEER.
8. SEE COE STD DTL TR-550 FOR POSSIBLE ROOT BARRIER INSTALLATION.
9. NATIVE SUBGRADE BEARING SOIL AND CSTC SHALL BE COMPACTED TO 95% MAXIMUM DENSITY.
10. ALL EDGES AND JOINTS SHALL HAVE 1/2" RADIUS

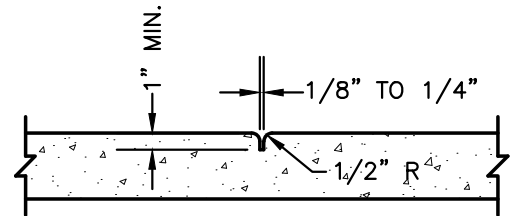

DUMMY JOINT
(NOT TO SCALE)



CITY OF EDMONDS
PUBLIC WORKS
DEPARTMENT

CONCRETE SIDEWALK

APPROVED BY: R. ENGLISH

REVISION DATE
APRIL 2021

STANDARD
DETAIL
TR-531