

**CITY BUILDING GHG COMPARISON****2006**

Main buildings	Electricity (kWh)	Natural gas (therms)	Equivalent CO2 (tonnes)	(%)**
City Hall	370,160	0	48	4.5
Edmonds Library	350,560	2,437	59	4.6
Fire Station 16	143,680	8,809	68	3
Pub. Safety / FS 17	864,640	7,794 / 4,637	156 / 26	12.4
Anderson Center	273,902	24,258	171	6.7
Public Works / Fleet	237,520	7,112 / 3,281	71 / 18	3.9
Yost Pool	99,760	17,602	112	3.6
Treatment Plant	4,202,400	13,685	621	54


**CITY FLEET FUEL CONSUMPTION****2006**

City department	Diesel (gallons)	Gasoline (gallons)	Total	(%)**
Pub. Wks. - W/S	3,279	14,910	18,189	*18.3
Pub. Wks. - S/S	14,176	4,242	18,418	*18.5
Pub. Wks. - other		3,434	3,434	*3.4
Parks and Rec.	845	8,113	8,958	9
Police	200	34,516	34,716	34.9
Fire	9,568	3,667	13,235	13
Dev. Services		2,400	2,400	2.4
Total	28,068	71,282	99,350	

\*Public Works sectors total 40.2% of consumption

\*\*Some percentages are rounded up

**CITY OF EDMONDS 2006 CITY BUILDING  
GREENHOUSE GAS COMPARISON  
(MAIN BUILDING EMISSIONS IN EQUIVALENT CO<sub>2</sub>)**

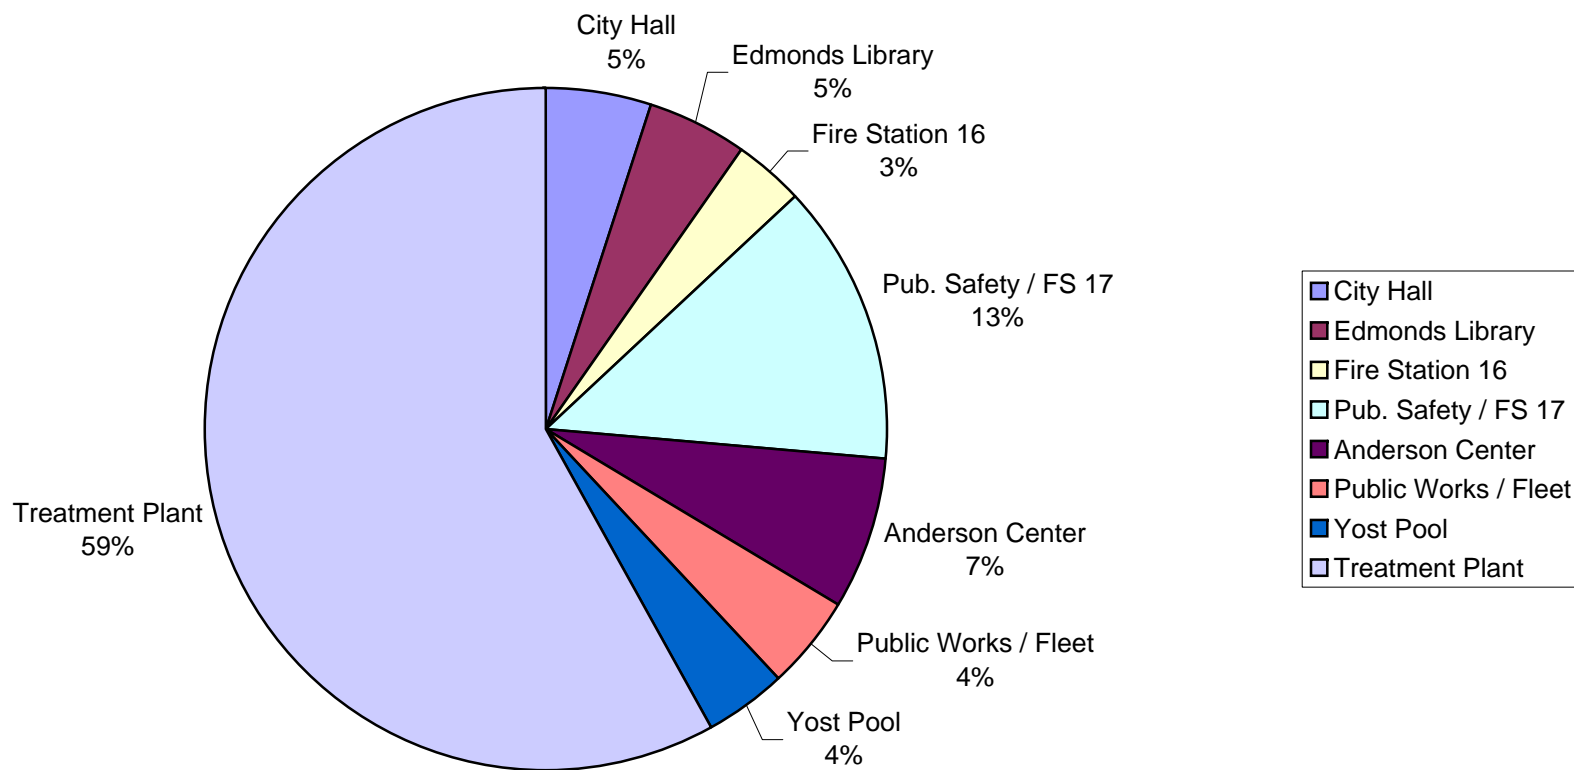

## 2006 CITY FLEET FUEL CONSUMPTION

